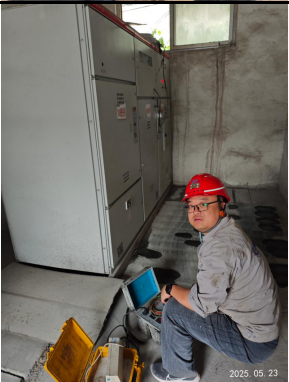


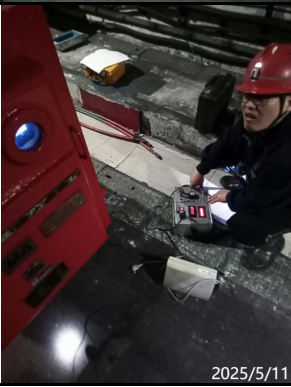
序号	报告编号	发布日期	结论	影像资料
281	GX-B1495/20-3-252311~252313	2025. 6. 18	所检项目合格。	
282	GX-B1329/21-3-25111	2025年6月18日	所检项目合格。	
283	GX-B1329/21-3-25112	2025年6月18日	所检项目合格。	

284	GX-B1451/20-3-25169	2025年6月18日	所检项目合格。	
285	GX-B1451/20-3-25170~25172	2025年6月18日	本次共检高压开关柜3台，3台高压开关柜所检项目合格。 。	
286	GX-B1451/20-3-25161~25168	2025年6月18日	本次共检高压开关柜8台，8台高压开关柜所检项目合格。 。	

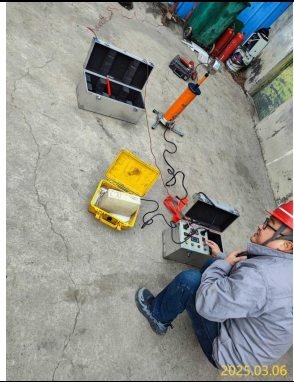
287	GX-B1500/21-3-25025	2025年6月18日	见报告第3页。	
288	GX-B1500/21-3-25026	2025年6月18日	见报告第3页。	
289	GX-B1495/20-3-252307~252309	2025年6月18日	本次共检高压开关设备3台，3台高压开关设备所检项目合格。	

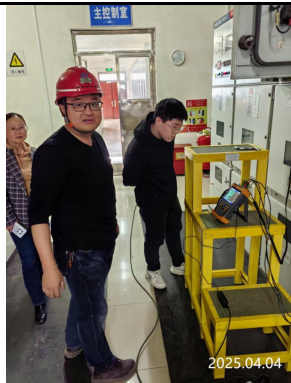
290	GX-B1620/24-3-25116	2025年6月18日	实测流量 1124.4m ³ /h、电机 输入功率 3033.4kW，不做判 定，其余所检项目 合格。			
291	GX-B1620/24-3-25117	2025年6月18日	实测流量 1136.4m ³ /h、电机 输入功率 3041.4kW，不做判 定，其余所检项目 合格。			
292	GX-B1620/24-3-25118	2025年6月18日	实测流量 713.4m ³ /h、电机 输入功率 551.1kW，不做判 定，其余所检项目 合格。			

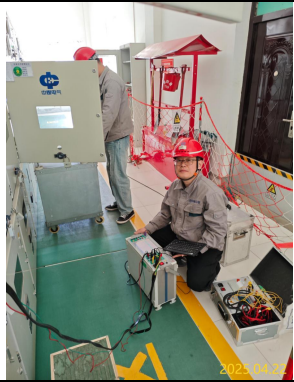
293	GX-B1495/20-3-252206~252230	2025年6月18日	本次共检高压开关设备25台，25台高压开关设备所检项目合格。	
294	GX-B1495/20-3-252231~252247	2025年6月18日	本次共检高压开关设备17台，17台高压开关设备所检项目合格。	
295	GX-B1495/20-3-252248~252272	2025年6月18日	本次共检高压开关设备25台，25台高压开关设备所检项目合格。	

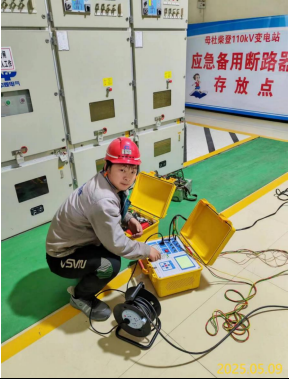
296	GX-B1495/20-3-252273~252282	2025年6月18日	本次共检高压开关设备10台，10台高压开关设备所检项目合格。			
297	GX-B1495/20-3-252283~252288	2025年6月18日	本次共检高压开关设备6台，6台高压开关设备所检项目合格。			
298	GX-B1495/20-3-252289~252292	2025年6月18日	本次共检高压开关设备4台，4台高压开关设备所检项目合格。			

299	GX-B1495/20-3-252293~252303	2025年6月18日	本次共检高压开关设备11台，11台高压开关设备所检项目合格。	 A worker in a red hard hat and safety vest stands next to a large electrical cabinet, pointing at a control panel. The date stamp in the bottom right corner of the photo is 2025/3/13.
300	GX-B1495/20-3-25980~25988	2025年6月17日	本次共检高压开关设备9台，9台高压开关设备所检项目合格。	 A worker in a red hard hat and safety vest is kneeling on the floor, working on a piece of equipment in a room with yellow and black striped safety barriers. The date stamp in the bottom right corner of the photo is 2025.05.01.
301	GX-B1495/20-3-25989~25998	2025年6月17日	本次共检高压开关设备10台，10台高压开关设备所检项目合格。	 A worker in a red hard hat and safety vest is standing next to a large electrical cabinet, working on a component. The date stamp in the bottom right corner of the photo is 2025.05.02.

302	GX-B1495/20-3-25999~251015	2025年6月17日	本次共检高压开关设备17台，17台高压开关设备所检项目合格。	
303	GX-B1329/21-3-25190~25201	2025年6月19日	本次共检氧化锌避雷器12组，12组氧化锌避雷器所检项目合格。	
304	GX-B1329/21-3-25211~25218	2025. 6. 18	所检项目合格。	

305	GX-B1404/20-3-25027	2025年6月17日	所检电网谐波电压总谐波畸变率、各次谐波电压含有率、谐波电流符合 GB/T 14549-1993 《电能质量 公用电网谐波》要求。	
306	GX-B1404/20-3-25044	2025年6月17日	所检电网谐波电压总谐波畸变率、各次谐波电压含有率、谐波电流符合 GB/T 14549-1993 《电能质量 公用电网谐波》要求。	
307	GX-B1495/20-3-251016~251026	2025年6月19日	本次共检高压开关设备11台，11台高压开关设备所检项目合格。	

308	GX-B1495/20-3-251070~251080	2025年6月19日	本次共检高压开关设备11台，11台高压开关设备所检项目合格。	
309	GX-B1495/20-3-251050~251061	2025年6月19日	本次共检高压开关设备12台，12台高压开关设备所检项目合格。	
310	GX-B1495/20-3-251062~251069	2025年6月19日	本次共检高压开关设备8台，8台高压开关设备所检项目合格。	

311	GX-B1495/20-3-251081~251084	2025年6月19日	本次共检高压开关设备4台，4台高压开关设备所检项目合格。	
312	GX-B1495/20-3-251085~251102	2025年6月19日	本次共检高压开关设备18台，18台高压开关设备所检项目合格。	
313	GX-B1495/20-3-251103~251114	2025年6月19日	本次共检高压开关设备12台，12台高压开关设备所检项目合格。	

314	GX-B1495/20-3-251115~251123	2025年6月19日	本次共检高压开关设备9台，9台高压开关设备所检项目合格。	
315	GX-B1495/20-3-251124~251128	2025年6月19日	本次共检高压开关设备5台，5台高压开关设备所检项目合格。	
316	GX-B1495/20-3-251129~251143	2025年6月19日	本次共检高压开关设备15台，15台高压开关设备所检项目合格。	

317	GX-B1495/20-3-251144~251157	2025年6月19日	设备14台，14台高压开关	 A photograph showing two workers in a substation aisle. One worker is standing and looking at the camera, while the other is kneeling and working on a piece of equipment on the floor. The aisle is lined with rows of electrical cabinets. A yellow toolbox and some cables are on the floor. The date stamp '2025.05.25' is visible in the bottom right corner.
318	GX-B1323/21-3-25504~25507	2025年6月20日	所检项目合格。	 A photograph of a worker in a grey uniform and red hard hat standing next to a large electrical cabinet. The worker is looking at the camera. The date stamp '2025.04.22' is visible in the bottom right corner.
319	GX-B1323/21-3-25500~25503	2025年6月20日	所检项目合格。	 A photograph of a worker in a grey uniform and red hard hat standing next to a large electrical cabinet. The worker is looking at the camera. The date stamp '2025.05.09' is visible in the bottom right corner.

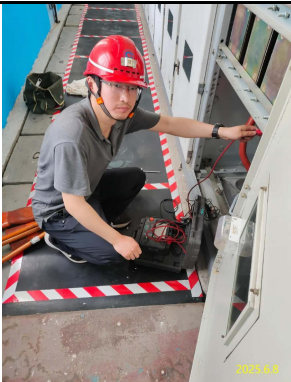
320	GX-B1328/20-3-25163	2025年6月18日	本次共检绝缘手套4只，4只绝缘手套合格。	
321	GX-B1328/20-3-25164	2025年6月18日	本次共检绝缘靴4只，4只绝缘靴合格。	
322	GX-B1495/20-3-251158~251162	2025年6月20日	本次共检高压开关设备5台，5台高压开关设备所检项目合格。	 2025.05.07
323	GX-B1308/23-3-25024	2025年6月20日	综合判定：合格。	 2025.05.28

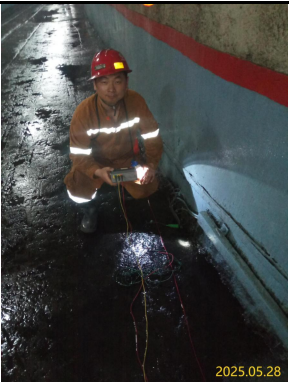
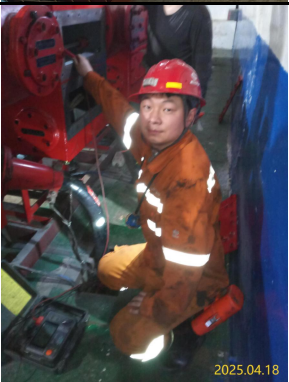
324	GX-B1321/20-3-251450~251457		本次共检电力电缆 8条，8条电力电缆 所检项目合格。	
325	GX-B1321/20-3-251458~251466		本次共检电力电缆 9条，9条电力电缆 所检项目合格。	
326	GX-B1321/20-3-251467~251471	2025年6月21日	本次共检电力电缆 5条，5条电力电缆 所检项目合格。	

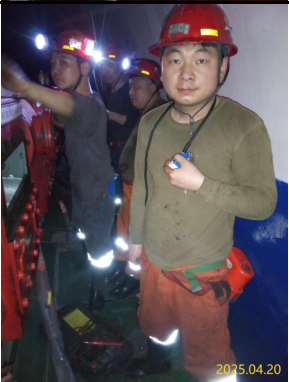
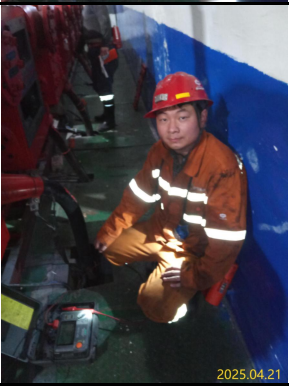
327	GX-B1321/20-3-251480~251485	2025年6月21日	本次共检电力电缆 6条，6条电力电缆 所检项目合格。	
328	GX-B1321/20-3-251472~251479	2025年6月21日	本次共检电力电缆 8条，8条电力电缆 所检项目合格。	
329	GX-B1321/20-3-251486~251491	2025年6月21日	本次共检电力电缆 6条，6条电力电缆 所检项目合格。	

330	GX-B1321/20-3-251500~251511	2025年6月21日	本次共检电力电缆12条，12条电力电缆所检项目合格。		 2025.05.24
331	GX-B1321/20-3-251512~251524	2025年6月21日	本次共检电力电缆13条，13条电力电缆所检项目合格。		 2025.05.25
332	GX-B1324/21-3-25036~25041	2025. 6. 23	所检项目合格。		 2025.6.7

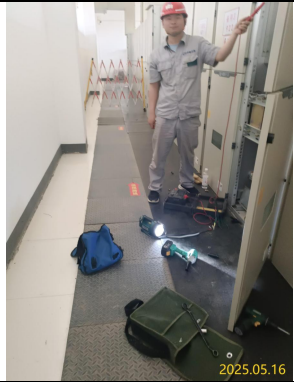
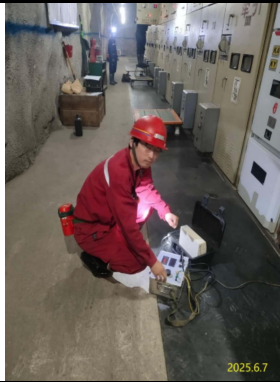
333	GX-B1301/25-3-25008	2025年6月23日	综合判定:合格。	
334	GX-B1328/20-3-25171	2025年6月24日	本次共检绝缘杆 1套, 1套绝缘杆合格。	
335	GX-B1322/21-3-25128~25147	2025. 6. 23	所检项目合格。	

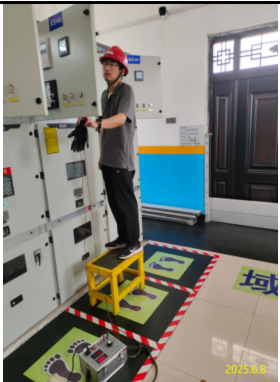
336	GX-B1322/21-3-25148~25152	2025. 6. 23	所检项目合格。	
337	GX-B1350/21-3-25020	2025年6月23日	本次共检验接地装置12处，12处所检项目合格。	
338	GX-B1350/21-3-25021	2025年6月23日	本次共检验接地装置9处，9处所检项目合格。	

339	GX-B1350/21-3-25022	2025年6月23日	本次共检验接地装置3处，3处所检项目合格。		 2025.05.28	
340	GX-B1337/22-3-25001~25036	2025年6月24日	本次共检电流互感器36只，36只所检项目合格。		 2025.6.7	
341	GX-B1336/22-3-25100	2025年6月24日	所检项目合格。		 2025.04.18	

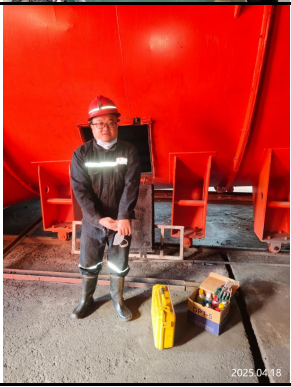
342	GX-B1336/22-3-25101	2025年6月24日	所检项目合格。			
343	GX-B1336/22-3-25102	2025年6月24日	所检项目合格。			
344	GX-B1336/22-3-25103	2025年6月24日	所检项目合格。			

345	GX-B1336/22-3-25104~25105	2025年6月24日	本次共检母线 2段，2段母线所检 项目合格。	 2025.04.26
346	GX-B1336/22-3-25106~25107	2025年6月24日	本次共检母线 2段，2段母线所检 项目合格。	 2025.04.27
347	GX-B1336/22-3-25111~25116	2025年6月24日	本次共检母线 6段，6段母线所检 项目合格。	 2025.05.01

348	GX-B1336/22-3-25117~25122	2025年6月24日	本次共检母线6段，6段母线所检项目合格。	
349	GX-B1336/22-3-25123~25132	2025年6月24日	本次共检母线10段，10段母线所检项目合格。	
350	GX-B1451/20-3-25182~25199	2025年6月24日	本次共检高压开关设备18台，18台高压开关设备所检项目合格。	

351	GX-B1451/20-3-25200~25206	2025年6月24日	本次共检高压开关设备7台，7台高压开关设备所检项目合格。	
352	GX-B1310/21-3-25139	2025年6月25日	未发现超过Φ2mm当量直径的缺陷。	
353	GX-B1427/21-3-25042	2025年6月25日	符合标准要求。	

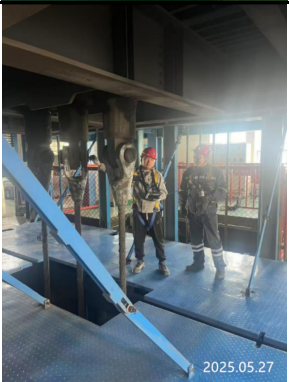
354	X-B1310/21-3-25142	2025年6月25日	符合标准要求。	
355	GX-B1301/25-3-25009	20025年6月25日	综合判定:合格。	
356	GX-B1329/21-3-25220~25224	2025年6月24日	本次共检氧化锌避雷器5组，5组氧化锌避雷器所检项目合格。	

357	GX-B1329/21-3-25225~25245	2025年6月24日	本次共检氧化锌避雷器21组，21组氧化锌避雷器所检项目合格。	
358	GX-B1329/21-3-25246~25266	2025年6月24日	本次共检氧化锌避雷器21组，21组氧化锌避雷器所检项目合格。	
359	GX-B1310/21-3-25137	2025年6月25日	符合标准要求。	

360	GX-B1310/21-3-25138	2025年6月25日	符合标准要求。		
361	GX-B1428/21-3-25050	2025年6月25日	无缺陷迹痕显示。		
362	GX-B1428/21-3-25051	2025年6月25日	无缺陷迹痕显示。		

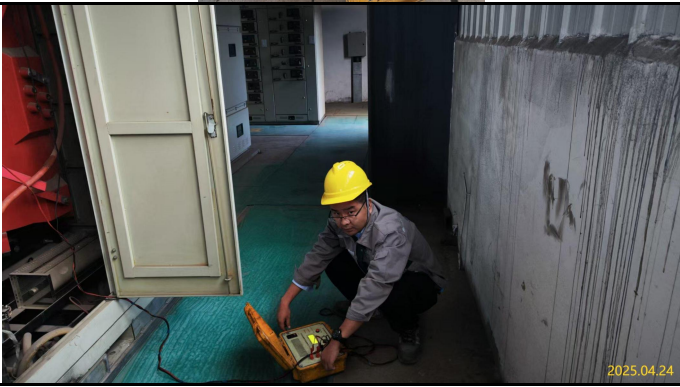
363	GX-B1427/21-3-25034	2025年6月25日	符合标准要求。	
364	GX-B1310/21-3-25135	2025年6月25日	符合标准要求。	
365	GX-B1427/21-3-25033	2025年6月25日	符合标准要求。	

366	GX-B1310/21-3-25136	2025年6月25日	符合标准要求。	
367	GX-B1427/21-3-25039	2025年6月25日	符合标准要求。	
368	GX-B1310/21-3-25144	2025年6月25日	符合标准要求。	

369	GX-B1427/21-3-25040	2025年6月25日	符合标准要求。	
370	GX-B1310/21-3-25145	2025年6月25日	符合标准要求。	
371	GX-B1427/21-3-25038	2025年6月25日	符合标准要求。	

372	GX-B1310/21-3-25143	2025年6月25日	符合标准要求。	
373	GX-B1427/21-3-25037	2025年6月25日	符合标准要求。	
374	GX-B1310/21-3-25140	2025年6月25日	符合标准要求。	

375	GX-B1427/21-3-25036	2025年6月25日	符合标准要求。	
376	GX-B1310/21-3-25141	2025年6月25日	符合标准要求。	
377	GX-B1312/20-3-25340~25345	2025年6月23日	本次共检电力变压器6台，6台电力变压器所检项目合格。 。	

378	GX-B1312/20-3-25760~25761	2025年6月23日	本次共检电力变压器2台，2台电力变压器所检项目合格。 。	
379	GX-B1312/20-3-25764~25765	2025年6月23日	本次共检防爆干式变压器2台，2台防爆干式变压器所检项目合格。	
380	GX-B1312/20-3-25772~25777	2025年6月23日	本次共检电力变压器6台，6台电力变压器所检项目合格。 。	

381	GX-B1312/20-3-25766~25771	2025年6月23日	本次共检电力变压器6台，6台电力变压器所检项目合格。 。	 2025.05.06
382	GX-B1312/20-3-25763	2025年6月23日	所检项目合格。	 2025.06.07
383	GX-B1328/20-3-25135	2025年6月26日	本次共检绝缘手套170只，170只绝缘手套合格。	 2025.04.20

384	GX-B1328/20-3-25136	2025年6月26日	本次共检绝缘靴 170只，170只绝缘 靴合格。	
385	GX-B1312/20-3-25762	2025年6月27日	所检项目合格。	
386	GX-B1312/20-3-25802~25803	2025年6月27日	本次共检电力变压器 2台，2台电力变 压器所检项目合格 。	