

序号	报告编号	发布日期	结论	影像资料
30	GX-B1323/21-1-25344~25346	2025. 7. 4	所检项目合格。	
31	GX-B1323/21-1-25347~25349	2025. 7. 4	所检项目合格。	

32	GX-B1323/21-1-25350~25355	2025. 7. 4	所检项目合格。	
33	GX-B1323/21-1-25356~25357	2025. 7. 4	所检项目合格。	

34	GX-B1574/20-1-25005	2025. 7. 4	所检项目合格。	
35	GX-B1574/20-1-25006	2025. 7. 4	所检项目合格。	

36	GX-B1574/20-1-25007	2025. 7. 4	所检项目合格。	
37	GX-B1534/20-1-25042	2025. 7. 4	所检项目合格。	

38	GX-B1312/20-1-25389~25393	2025. 7. 7	本次共检电力变压器5台，5台电力变压器所检项目合格	
39	GX-B1312/20-1-25394~25404	2025. 7. 7	本次共检电力变压器11台，11台电力变压器所检项目合格	

40	GX-B1312/20-1-25505~25509	2025. 7. 8	<p>本次共检电力变压器5台，5台电力变压器所检项目合格。</p> <p>。</p>	
41	GX-B1312/20-1-25503~25504	2025. 7. 8	<p>本次共检电力变压器2台，2台电力变压器所检项目合格。</p>	

42	GX-B1321/20-1-251061	2025. 7. 8	所检项目合格。	
43	GX-B1321/20-1-251062~251072	2025. 7. 8	本次共检电力电缆11条，11条电力电缆所检项目合格。	

44	GX-B1321/20-1-251073~251078	2025. 7. 8	本次共检电力电缆6条，6条电力电缆所检项目合格。	
45	GX-B1495/25-1-251890~251909	2025. 7. 8	本次共检高压防爆开关20台，20台高压防爆开关所检项目合格。	

46	GX-B1495/25-1-251910~251915	2025. 7. 8	本次共检高压防爆开关6台，6台高压防爆开关所检项目合格。	
47	GX-B1598/24-1-25042	2025. 7. 8	实测钢丝绳有效截面积损失百分比最大为1.26%，小于5%为正常	

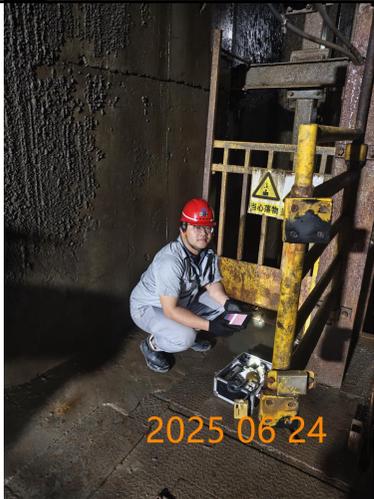
48	GX-B1598/24-1-25043	2025. 7. 8	实测钢丝绳有效截面积损失百分比最大为1.61%，小于5%为正常	
49	GX-B1598/24-1-25044	2025. 7. 8	实测钢丝绳有效截面积损失百分比最大为1.76%，小于5%为正常	

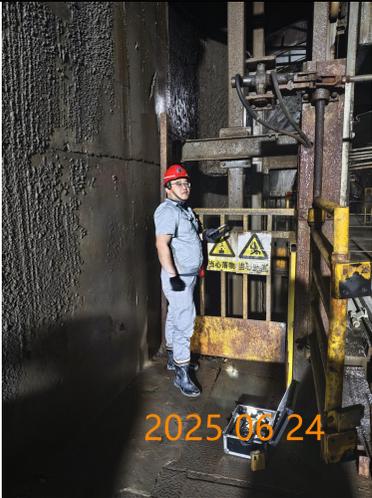
50	GX-B1598/24-1-25045	2025. 7. 8	实测钢丝绳有效截面积损失百分比最大为1.92%，小于5%为正常	
51	GX-B1598/24-1-25038	2025. 7. 8	实测钢丝绳有效截面积损失百分比最大为1.67%，小于5%为正常	

52	GX-B1598/24-1-25039	2025. 7. 8	实测钢丝绳有效截面积损失百分比最大为1.36%，小于5%为正常	 <p>2025/6/25</p>
53	GX-B1598/24-1-25040	2025. 7. 8	实测钢丝绳有效截面积损失百分比最大为1.58%，小于5%为正常	 <p>2025/6/25</p>

54	GX-B1598/24-1-25041	2025. 7. 8	实测钢丝绳有效截面积损失百分比最大为1.59%，小于5%为正常	
55	GX-B1598/24-1-25046	2025. 7. 10	实测钢丝绳有效截面积损失百分比最大为1.96%，小于5%为正常	

56	GX-B1598/24-1-25047	2025. 7. 10	实测钢丝绳有效截面积损失百分比最大为1.99%，小于5%为正常	
57	GX-B1598/24-1-25048	2025. 7. 10	实测钢丝绳有效截面积损失百分比最大为1.94%，小于5%为正常	

58	GX-B1598/24-1-25049	2025. 7. 10	实测钢丝绳有效截面积损失百分比最大为2.02%，小于5%为正常	
59	GX-B1598/24-1-25050	2025. 7. 10	实测钢丝绳有效截面积损失百分比最大为2.06%，小于5%为正常	

60	GX-B1598/24-1-25051	2025. 7. 10	实测钢丝绳有效截面积损失百分比最大为2.16%，小于5%为正常	
61	GX-B1352/21-1-25358~25364	2025. 7. 10	本次共检矿用防爆低压交流真空馈电开关7台,7台所检项目合格	

62	GX-B1352/21-1-25365~25368	2025. 7. 10	<p>本次共检矿用防爆低压交流真空馈电开关漏电保护4台，4台所检项目合格</p>	
63	GX-B1359/21-1-25144~25148	2025. 7. 10	<p>本次共检矿用隔爆型照明信号综合保护装置5台，5台所检项目合格</p>	