

序号	报告编号	发布日期	结论	影像资料
121	GX-B1328/25-5-25250	2025. 12. 26	本次共检绝缘手套 6只，6只绝缘手套合格。	
122	GX-B1328/25-5-25251	2025. 12. 26	本次共检绝缘靴6只， 6只绝缘靴合格。	

123	GX-B1328/25-5-25248	2025. 12. 26	本次共检绝缘手套30只，30只绝缘手套合格。	
124	GX-B1328/25-5-25249	2025. 12. 26	本次共检绝缘靴30只，30只绝缘靴合格。	

125	GX-B1321/20-5-25943~25948	2025. 12. 26	本次共检电力电缆6条，6条电力电缆所检项目合格。	
126	GX-B1321/20-5-25975~25980	2025. 12. 29	本次共检电力电缆6条，6条电力电缆所检项目合格。	

127	GX-B1312/20-5-25783~25784	2025. 12. 26	本次共检电力变压器2台，2台电力变压器所检项目合格。	
128	GX-B1310/21-5-25335	2025. 12. 29	符合标准要求。	 

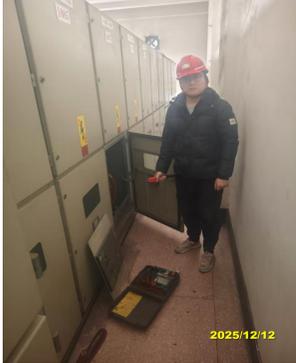
129	GX-B1329/21-5-25323~25324	2025. 12. 29	本次共检氧化锌避雷器2组，2组所检项目合格。	
130	GX-B1495/25-5-251474~251477	2025. 12. 29	本次共检高压开关柜4台，4台高压开关柜所检项目合格。	

131	GX-B1310/21-5-25314	2025. 12. 29	符合标准要求。			
132	GX-B1310/21-5-25315	2025. 12. 29	符合标准要求。			

133	GX-B1328/25-5-25233	2025/12/30	本次共检绝缘手套22只，22只绝缘手套合格。	
134	GX-B1328/25-5-25234	2025/12/30	本次共检绝缘靴22只，22只绝缘靴合格。	

135	GX-B1328/25-5-25235	2025/12/30	本次共检验电器 12支，12支验电器合格。 。	
136	GX-B1328/25-5-25236	2025/12/30	本次共检便携式接地 和接地短路装置7套， 7套便携式接地和接地 短路装置合格。	

137	GX-B1312/20-5-25811	2025. 12. 30	所检项目合格。			
138	GX-B1323/21-5-25174~25176	2025. 12. 30	所检项目合格。			

139	GX-B1321/20-5-25949~25952	2025. 12. 30	本次共检电力电缆4条，4条电力电缆所检项目合格。	
140	GX-B1321/20-5-25953~25965	2025. 12. 30	本次共检电力电缆13条，13条电力电缆所检项目合格。	

141	GX-B1328/25-5-25237	2025. 12. 30	本次共检绝缘手套34只，34只绝缘手套合格。	
142	GX-B1328/25-5-25238	2025. 12. 30	本次共检绝缘靴80只，80只绝缘靴合格。	

143	GX-B1328/25-5-25239	2025. 12. 30	本次共检便携式接地和接地短路装置10套，10套便携式接地和接地短路装置合格。	
144	GX-B1328/25-5-25240	2025. 12. 30	本次共检验电器10只，10只验电器合格。	

145	GX-B1312/20-5-25814~25816	2025. 12. 30	本次共检电力变压器3台，3台电力变压器所检项目合格。	
146	GX-B1321/20-5-25986~25992	2025. 12. 30	本次共检电力电缆7条，7条电力电缆所检项目合格。	

147	GX-B1314/21-5-25013~25015	2025. 12. 30	本次共检干式电抗器3台，3台干式电抗器所检项目合格。	 A photograph showing two workers in safety gear (hard hats and high-visibility clothing) inspecting a dry-type reactor inside an electrical cabinet. The workers are wearing red and black helmets. The reactor is a large, cylindrical component with multiple windings. The date '2025/12/8' is visible in the bottom right corner of the photo.
148	GX-B1321/20-5-25966~25974	2025/12/30	本次共检电力电缆9条，9条电力电缆所检项目合格。	 A photograph showing workers in safety gear inspecting power cables in a dark environment. The workers are wearing hard hats and high-visibility clothing. The scene is dimly lit, with a bright light source illuminating the workers and the cables. The date '2025/12/8' is visible in the bottom right corner of the photo.

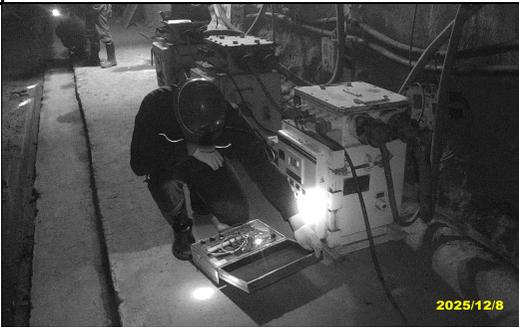
149	GX-B1312/20-5-25785~25790	2025年12月30	本次共检煤矿用防爆干式变压器6台，6台煤矿用防爆干式变压器所检项目合格。	 <p>A photograph showing a worker in a dark environment, likely a mine, inspecting a large, cylindrical industrial transformer. The worker is wearing a headlamp and safety gear. The transformer has a prominent metal grille and a warning sign. A timestamp '2025/12/8' is visible in the bottom right corner of the image.</p>
150	GX-B1312/20-5-25817~25818	2025. 12. 30	本次共检防爆干式变压器2台，2台防爆干式变压器所检项目合格。	 <p>A photograph showing a worker in a dark environment, likely a mine, inspecting a large industrial transformer. The worker is wearing a headlamp and safety gear. The transformer is a large, rectangular unit with a metal grille. A timestamp '2025/12/27' is visible in the bottom right corner of the image.</p>

151	GX-B1321/20-5-25993	2025. 12. 30	所检项目合格。	 <p>A photograph showing a worker in a hard hat and safety vest inspecting a piece of equipment in a dark environment. The worker is holding a tool or device. A timestamp '2025/12/27' is visible in the bottom right corner of the image.</p>
152	GX-B1351/21-5-25005~25006	2025. 12. 30	本次共检矿用隔爆型检漏继电器2台, 2台矿用隔爆型检漏继电器所检项目合格。	 <p>A photograph showing a worker in a hard hat and safety vest standing in a hallway next to a large piece of equipment. The worker is holding a tool or device. A timestamp '2025/12/8' is visible in the bottom right corner of the image.</p>

153	GX-B1323/21-5-25177~25180	2025. 12. 30	所检项目合格。	
154	GX-B1302/25-5-25002	2025/12/31	综合判定：合格。	

155	GX-B1310/21-5-25332	2025/12/30	符合标准要求。	
156	GX-B1310/21-5-25333	2025/12/30	符合标准要求。	

157	GX-B1428/21-5-25024	2025/12/30	无缺陷迹痕显示。	
158	GX-B1428/21-5-25025	2025/12/30	无缺陷迹痕显示。	

159	GX-B1352/21-5-25128~25139	2025/12/31	本次共检矿用防爆低压交流真空馈电开关12台,12台所检项目合格。	
160	GX-B1352/21-5-25140~25147	2025/12/31	本次共检矿用防爆低压交流真空馈电开关8台,8台所检项目合格。	

161	GX-B1352/21-5-25921~25923	2025/12/31	本次共检矿用防爆低压交流真空馈电开关漏电保护3台,3台防爆低压交流真空馈电开关漏电保护所检项目合格。	
162	GX-B1359/21-5-25222	2025/12/31	所检项目合格。	

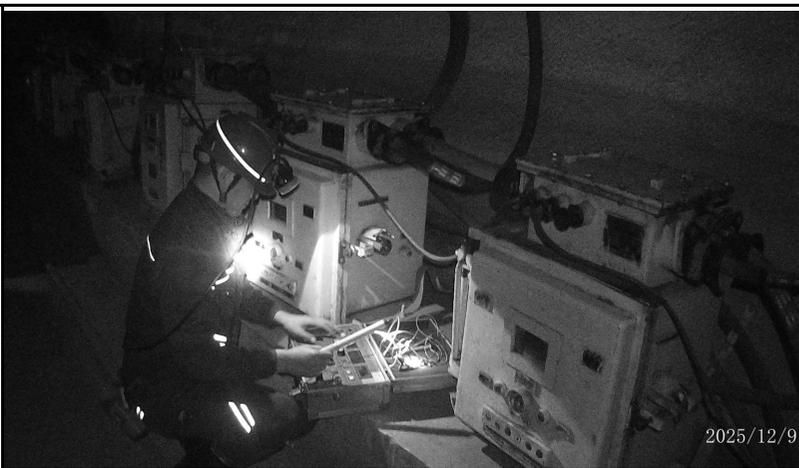
163	GX-B1352/21-5-25913~25917	2025. 12. 31	<p>本次共检矿用防爆低压交流真空馈电开关漏电保护5台,5台防爆低压交流真空馈电开关漏电保护所检项目合格。</p>	
164	GX-B1352/21-5-25918~25919	2025. 12. 31	<p>本次共检矿用防爆低压交流真空馈电开关漏电保护2台,2台防爆低压交流真空馈电开关漏电保护所检项目合格。</p>	

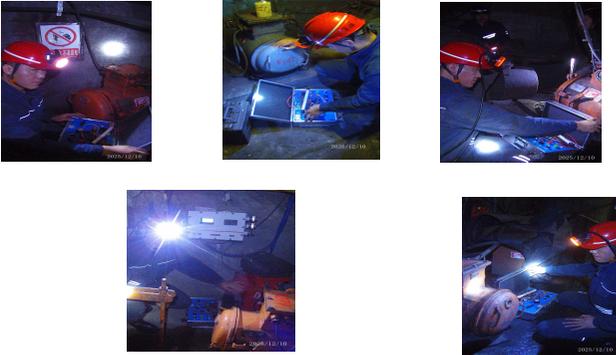
165	GX-B1352/21-5-25087~25105	2025. 12. 31	本次共检矿用防爆低压交流真空馈电开关19台, 19台所检项目合格。		
166	GX-B1359/21-5-25181	2025. 12. 31	所检项目合格。		

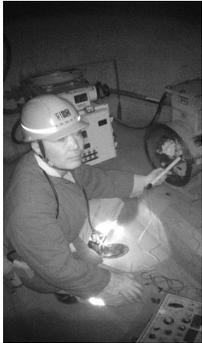
167	GX-B1359/21-5-25182~25198	2025. 12. 31	本次共检矿用隔爆型照明信号综合保护装置17台，17台所检项目合格。	
168	GX-B1359/21-5-25223~25230	2025. 12. 31	本次共检矿用隔爆型照明信号综合保护装置8台，8台所检项目合格。	

169	GX-B1312/20-5-25780~25782	2025. 12. 26	本次共检防爆干式变压器3台，3台防爆干式变压器所检项目合格。	
170	GX-B1321/20-5-25916~25920	2025. 12. 29	本次共检电力电缆6条，6条电力电缆所检项目合格。	

171	GX-B1495/25-5-251458~251460	2025. 12. 31	本次共检防爆型高压配电装置3台，3台防爆型高压配电装置所检项目合格。	 <p>DSJ_0000000_000000 2025/12/09 12:16:06</p>
172	GX-B1495/25-5-251461~251469	2025. 12. 31	本次共检高压开关柜9台，9台高压开关柜所检项目合格。	 <p>2025/12/9</p>

173	GX-B1352/21-5-25106~25116	2025. 12. 31	本次共检矿用防爆低压交流真空馈电开关11台, 11台所检项目合格。	 <p>2025/12/9</p>
174	GX-B1352/21-5-25117	2025. 12. 31	所检项目合格。	 <p>2025/12/10</p>

175	GX-B1359/21-5-25200~25214	2025. 12. 31	本次共检矿用隔爆型照明信号综合保护装置15台，15台所检项目合格。	
176	GX-B1310/21-5-25334	2025/12/30	符合标准要求。	

177	GX-B1359/21-5-25215~25221	2025. 12. 31	本次共检矿用隔爆型照明信号综合保护装置7台，7台所检项目合格	  
178	GX-B1352/21-5-25118~25127	2025. 12. 31	本次共检矿用防爆低压交流真空馈电开关10台，10台所检项目合格	  

179	GX-B1337/22-5-25001~25002	2025/12/30	本次共检电流互感器2只，2只所检项目合格。	
180	GX-B1328/25-5-25242	2025/12/31	本次共检绝缘手套176只，176只绝缘手套合格。	

181	GX-B1328/25-5-25243	2025/12/31	本次共检绝缘靴 88只，88只绝缘靴合格。 。	
182	GX-B1328/25-5-25244	2025/12/31	本次共检验电器 81支，81支验电器合格。 。	

183	GX-B1328/25-5-25245	2025/12/31	本次共检便携式接地和接地短路装置42套，42套便携式接地和接地短路装置合格。 。	
184	GX-B1328/25-5-25246	2025/12/31	本次共检绝缘杆10支，10支绝缘杆合格。 。	

185	GX-B1328/25-5-25247	2025/12/31	本次共检绝缘胶垫128个，128个绝缘胶垫合格。	
186	GX-B1352/21-5-25920	2025/12/31	所检项目合格。	

187	GX-B1559/22-5-25019	2025. 12. 31	所检项目合格。	 A photograph showing a person in a dark jacket operating a yellow excavator. The person is seated on the machine, and the background shows a blue sky and some industrial structures. A red date stamp '2025.12.31' is visible in the bottom right corner of the image.
188	GX-B1539/22-5-25021	2025. 12. 31	所检项目合格。	 A photograph showing a person in a dark jacket sitting inside the cab of a vehicle, possibly a truck or bus. The person is looking towards the camera. The background shows a blue sky and some industrial structures. A red date stamp '2025.12.31' is visible in the bottom right corner of the image.

189	GX-B1539/22-5-25020	2025. 12. 31	所检项目合格。	
190	GX-B1321/20-5-25981~25983	2025. 12. 31	本次共检电力电缆 3条，3条电力电缆所 检项目合格。	

191	GX-B1321/20-5-25984~25985	2025. 12. 31	本次共检电力电缆 2条，2条电力电缆所 检项目合格。	
192	GX-B1312/20-5-25812~25813	2025. 12. 31	本次共检防爆干式变 压器2台，2台防爆干 式变压器所检项目合 格。	

193	GX-B1312/20-5-25791~25792	2025. 12. 31	本次共检防爆干式变压器2台，2台防爆干式变压器所检项目合格。		 <p>2025/12/11</p>
194	GX-B1312/20-5-25793	2025. 12. 31	所检项目合格。		 <p>2025/12/8</p>

195	GX-B1312/20-5-25794~25800	2025. 12. 31	本次共检防爆干式变压器7台，7台防爆干式变压器所检项目合格。	 <p>2025/12/9</p>
196	GX-B1312/20-5-25801~25802	2025. 12. 31	本次共检电力变压器2台，2台电力变压器所检项目合格。	 <p>2025/12/11</p>

197	GX-B1312/20-5-25803~25808	2025. 12. 31	本次共检电力变压器6台，6台电力变压器所检项目合格。		 <p>2025/12/13</p>
198	GX-B1312/20-5-25809~25810	2025. 12. 31	本次共检电力变压器2台，2台电力变压器所检项目合格。		 <p>2025/12/12</p>

199	GX-B1495/25-5-251494~251516	2025/12/31	本次共检高压开关柜23台，23台高压开关柜所检项目合格。	
200	GX-B1495/25-5-251517~251526	2025/12/31	本次共检高压开关柜10台，10台高压开关柜所检项目合格。	

201	GX-B1495/25-5-251529~251531	2025/12/31	本次共检防爆高压配电装置3台，3台防爆高压配电装置所检项目合格。	
202	GX-B1495/25-5-251478~251485	2025/12/31	本次共检防爆高压配电装置8台，8台防爆高压配电装置所检项目合格。	

203	GX-B1495/25-5-251540~251546	2025. 12. 31	本次共检防爆高压配电装置7台，7台防爆高压配电装置所检项目合格。	
204	GX-B1495/25-5-251486~251493	2025. 12. 31	本次共检高压开关柜8台，8台高压开关柜所检项目合格。	

205	GX-B1495/25-5-251532~251539	2025. 12. 31	本次共检高压开关柜8台，8台高压开关柜所检项目合格。	
-----	-----------------------------	--------------	----------------------------	---